



NOTES:

- 1 PLACE (DO NOT SEAL) APPROPRIATE SIZED PVC CAP ON ALL CONDUIT ENDS. CONDUIT CAPS WILL BE RETURNED TO INSTALLERS AFTER CABLE HAS BEEN INSTALL IF REQUESTED.
- 2 INSTALL PULLSTRING IN EACH CONDUIT. LEAVING 36 INCHES OF SLACK AT EACH END. SECURE PULLSTRING TO CONDUIT WITH DUCT TAPE BELOW CAP AS SHOWN.
- 3 PULL STRING SHALL HAVE A MINIMUM BREAKING STRENGTH OF 200 LBS. PULL STRING SHALL BE NON BIODEGRADABLE.
- 4 DRAWING DOES NOT APPLY TO SECONDARY CONDUITS BETWEEN METER BASES AND SECONDARY PEDESTALS OR RISER POLES.

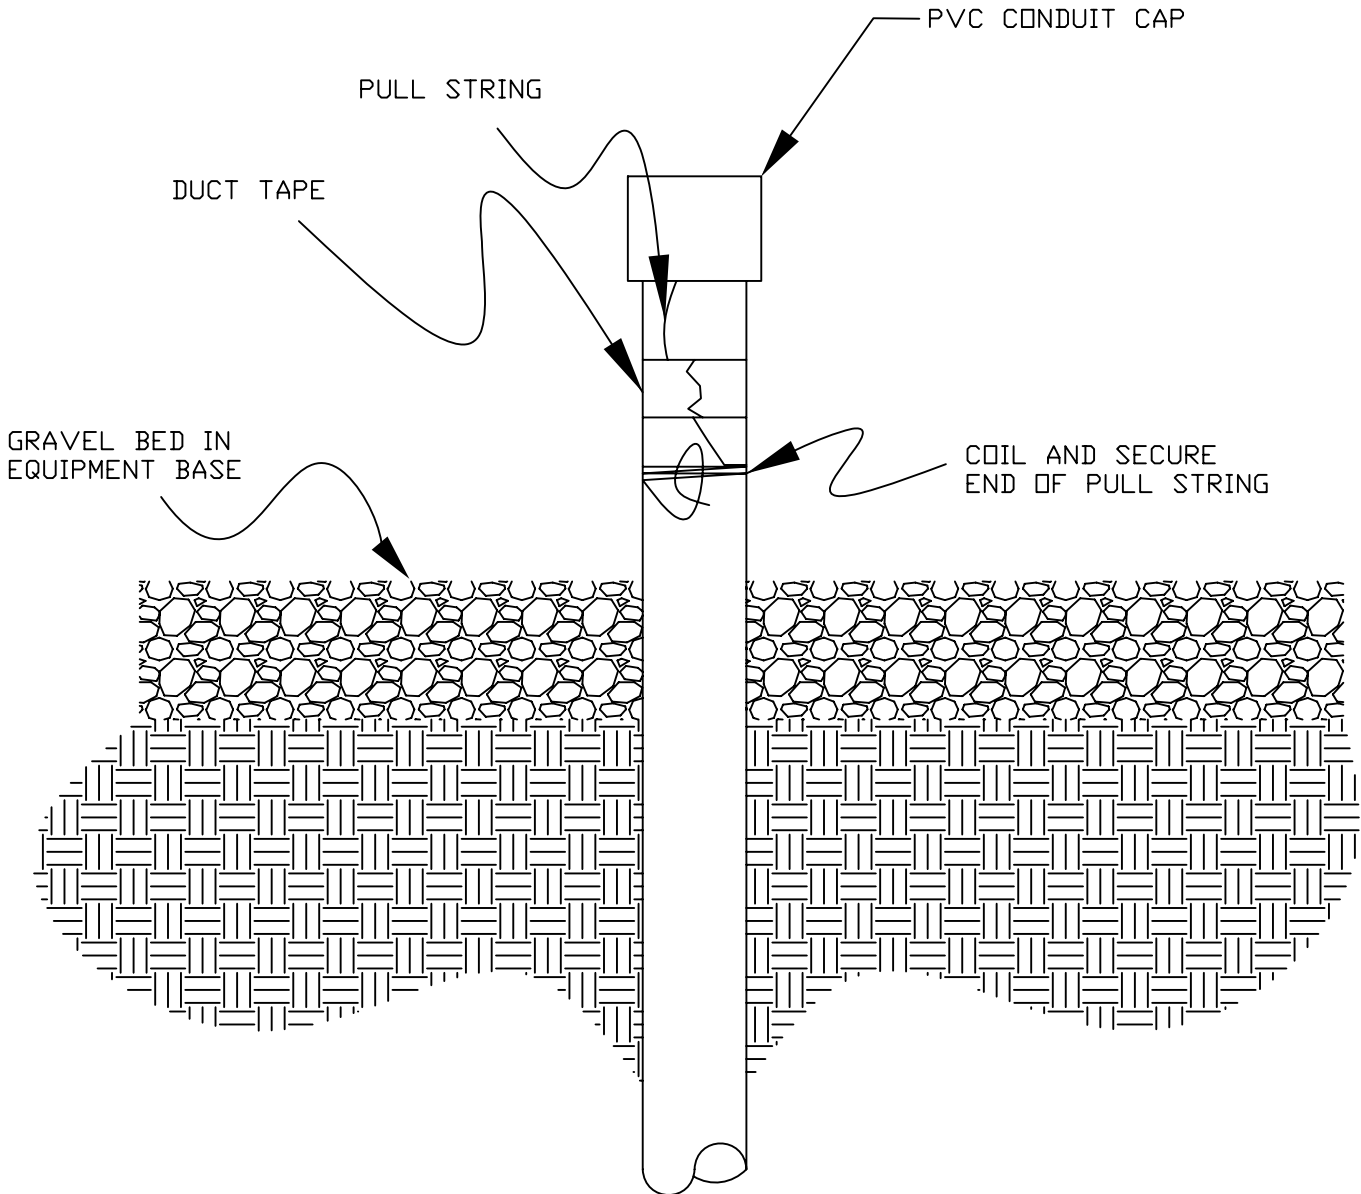

 <p>Coastal Electric Cooperative Your Touchstone Energy® Partner</p>	CONDUIT EXIT GUIDE DRAWING		REVISED
	DRAWN BY: CJH	APPROVED BY: JWM	
	DATE: 6-7-06	SCALE: NTS	